


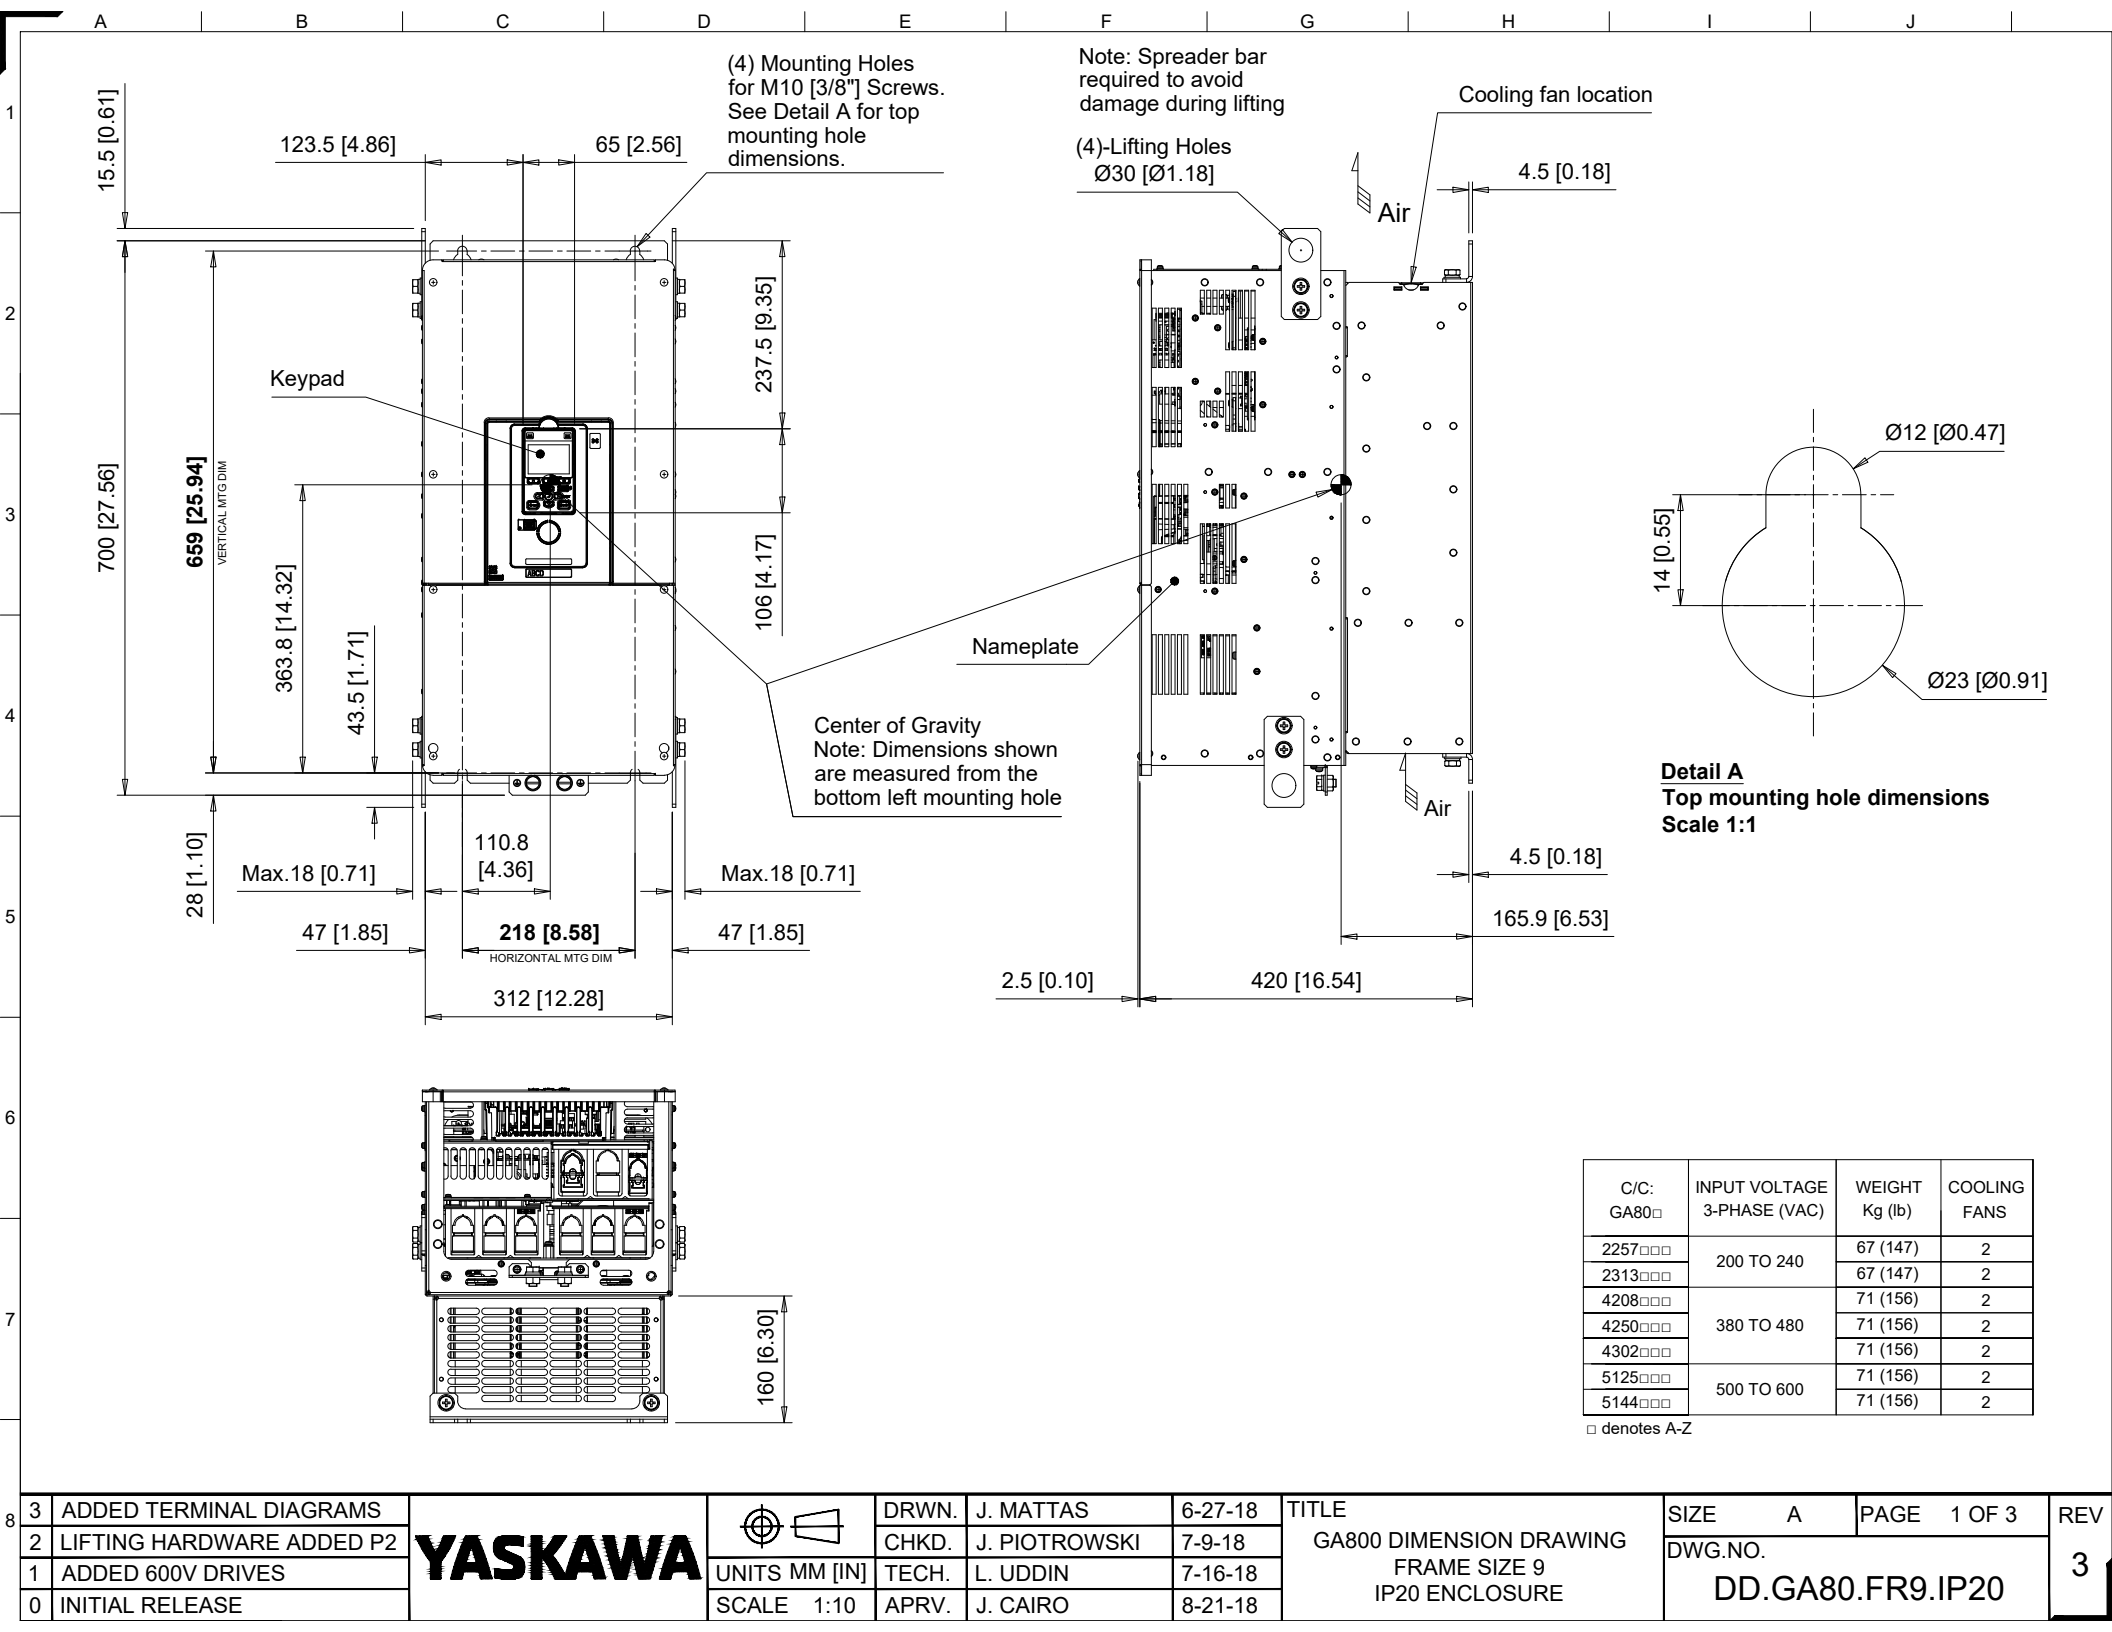
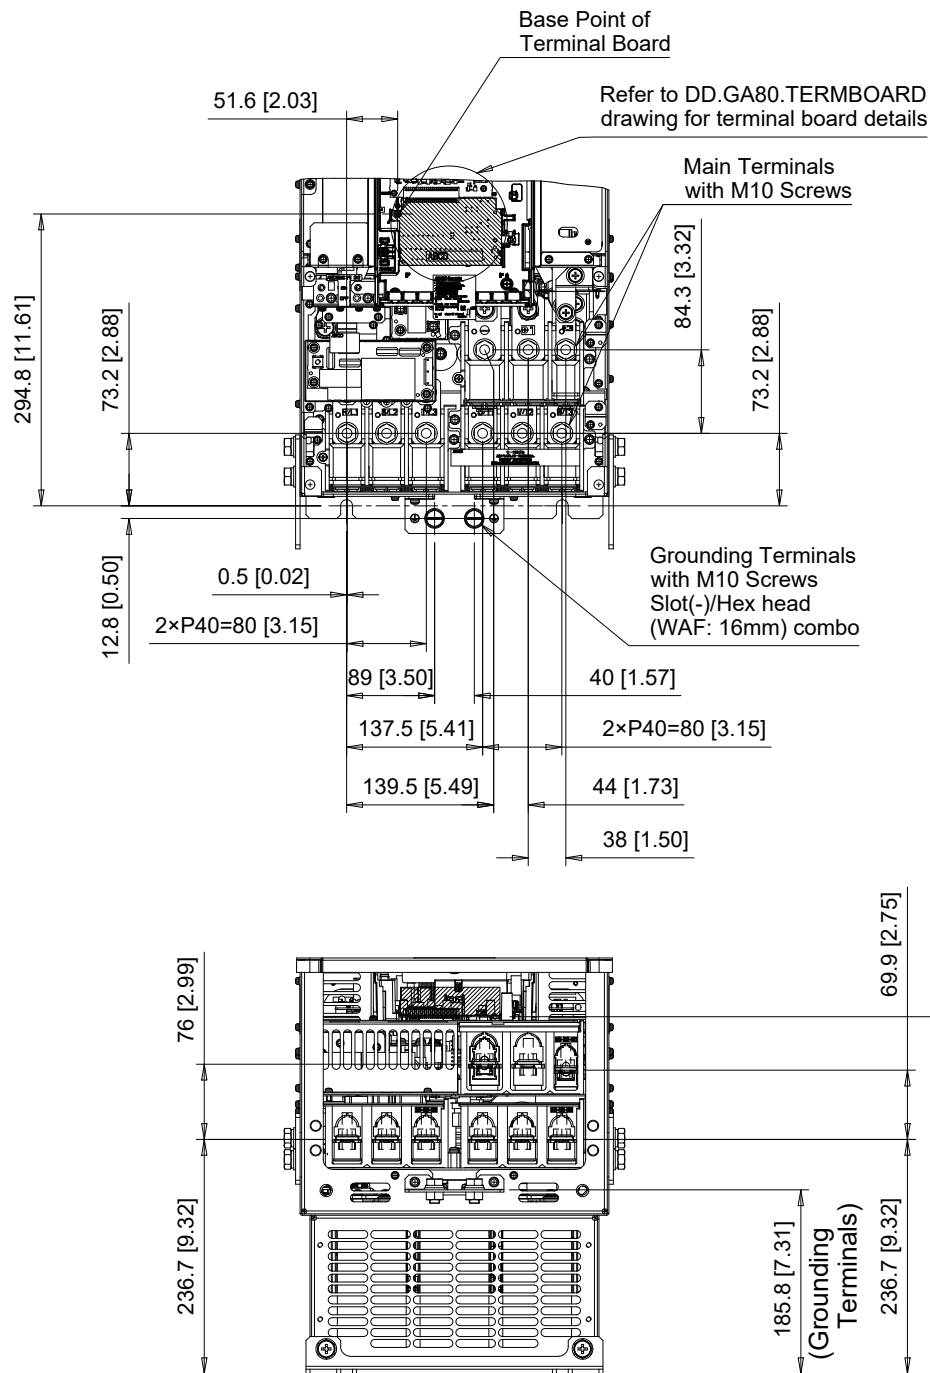
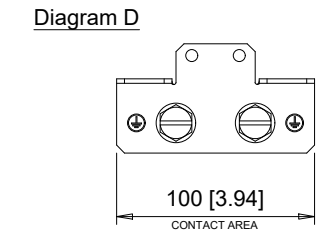


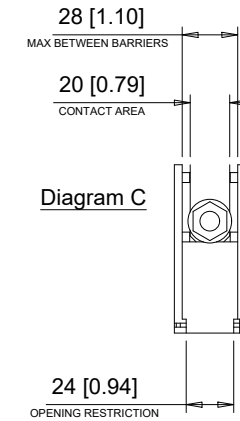

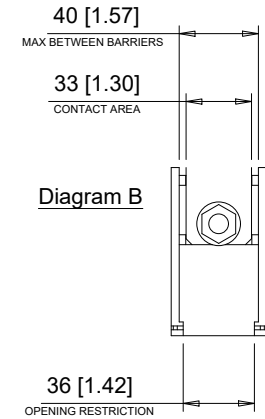

Simplified Terminal Diagrams (Scale 1:4)

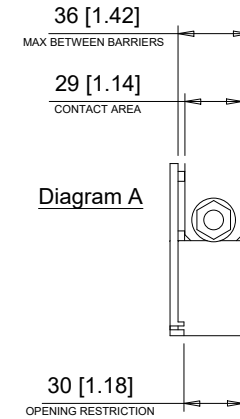


C/C: GA80□	TERMINAL SYMBOL	WIRE RANGE AWG (mm²)	TERMINAL SCREW	CLAMPING TORQUE N.m. (lb.in.)	TERMINAL DIAGRAM
2257□□□	R/L1, S/L2, T/L3	3 - 4/0 x 2P (30 - 120 x 2P)	M10	20 (177)	A
2313□□□	U/T1, V/T2, W/T3	3 - 4/0 x 2P (30 - 120 x 2P)	M10	20 (177)	A
4208□□□	-, +1	2 - 250 x 2P (35 - 120 x 2P)	M10	20 (177)	B
4250□□□	+3	2 - 250 x 2P (35 - 120 x 2P)	M10	20 (177)	C
4302□□□	⊕	2 - 350 (35 - 185)	M10	18 - 23 (159 - 204)	D
5125□□□					
5144□□□					

□ Denotes A-Z

Note: Refer to applicable codes and standards for proper wire type and size.

YASKAWA



UNITS MM [IN]

SCALE 1:8


DRWN.	J. MATTAS	6-27-18
CHKD.	J. PIOTROWSKI	7-9-18
TECH.	L. UDDIN	7-16-18
APRV.	J. CAIRO	8-21-18

TITLE
GA800 DIMENSION DRAWING
FRAME SIZE 9
IP20 ENCLOSURE

SIZE A
PAGE 2 OF 3
DWG.NO.
DD.GA80.FR9.IP20

REV
3


Minimum Installation Clearances

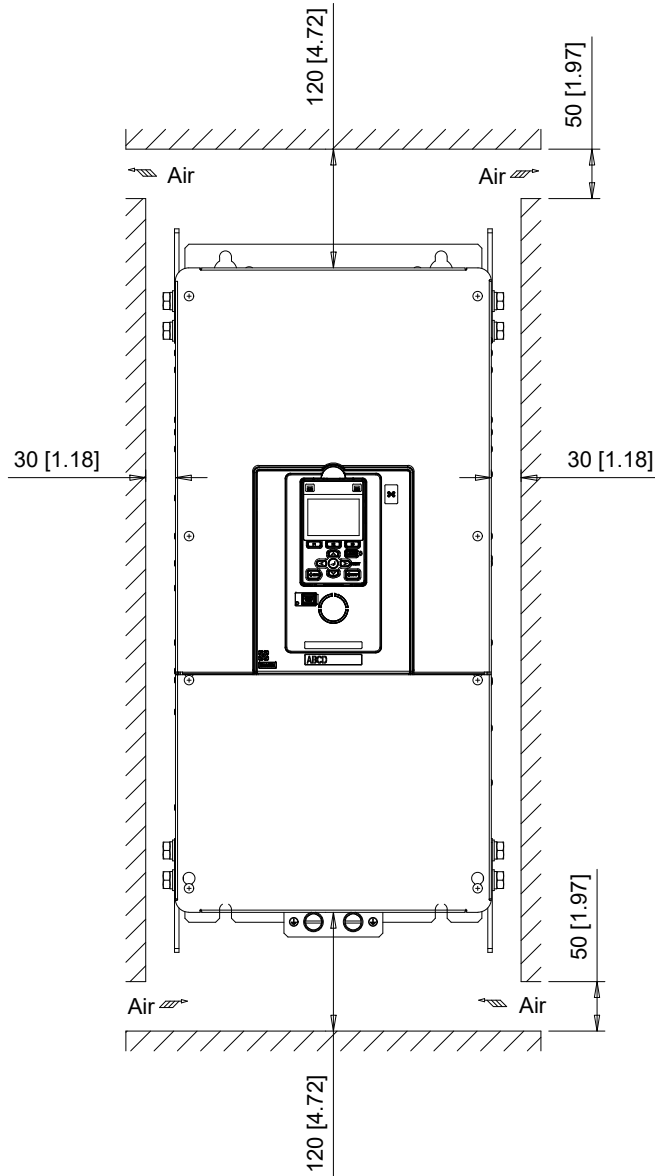

Note:
For alternate mounting configurations, consult manual.


Panel Cutout For External Heatsink Mounting Configuration

(4) - M10 [3/8"]
Tapped Hole

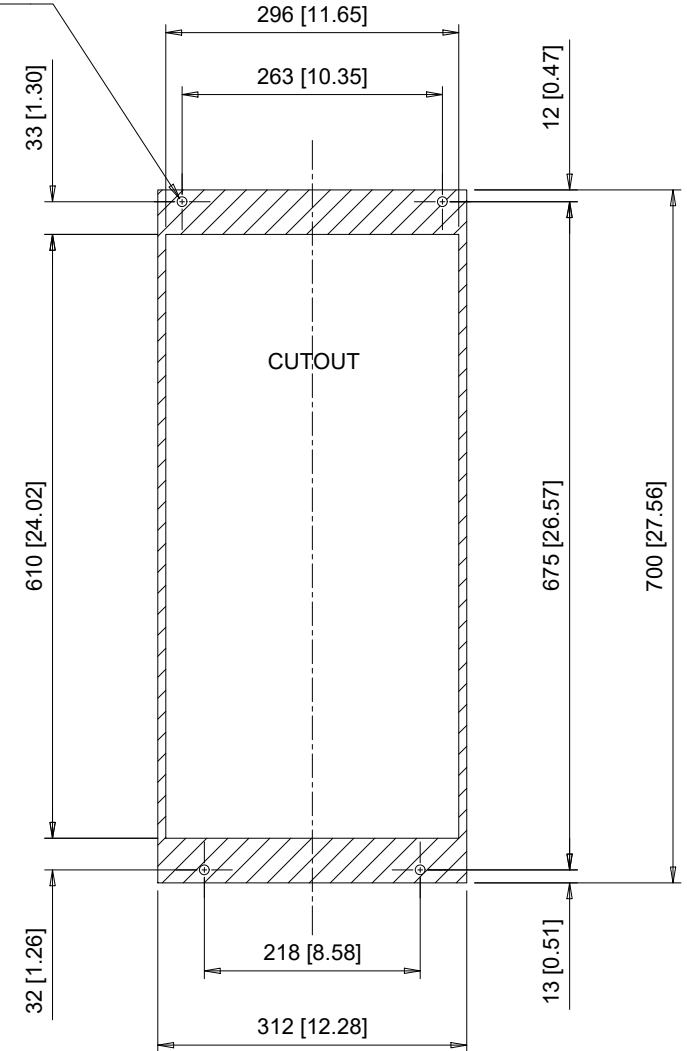

Notes:
Exposed heatsink minimum clearance D = 165 [6.50].
Refer to external heatsink instructions document for additional details.

YASKAWA



UNITS MM [IN]
SCALE 1:8

DRWN.	J. MATTAS	6-27-18
CHKD.	J. PIOTROWSKI	7-9-18
TECH.	L. UDDIN	7-16-18
APRV.	J. CAIRO	8-21-18

TITLE
GA800 DIMENSION DRAWING
FRAME SIZE 9
IP20 ENCLOSURE

SIZE	A	PAGE	3 OF 3
DWG.NO.	DD.GA80.FR9.IP20		

REV
3